

CITY OF GROVEPORT
REPORT TO MAYOR AND COUNCIL
MARCH 15, 2013

ADMINISTRATION – *Marsha Hall*

- Below is a status of on-going items requested by Council:
 - Electrical outages in the southeast portion of the city – *AEP's outage report for three areas is being provided to you with this report.*
 - Lighting on Homer Ohio Lane – Dennis Moore has a work order in with AEP.
 - "No Parking" issues Tallman and Green – We are currently reviewing.
 - Wirt Road sidewalks, lights – *We are waiting for ODOT's approval..*
 - Bixby Rd. middle striping – Dennis has this scheduled. There are areas of the roadway that needs patching before the striping is done. All work should be completed by late Spring.
- *Tom Byrne is starting work today, March 18. He will be at the Committee of the Whole meeting for introductions.*
- I have asked the Finance Director to include an additional \$3,000 in the proposed 2013 Appropriations amendments on this meeting's agenda. This is in response to a grant request by the Groveport Heritage & Preservation Society, and would be used as part of a larger project for an oral history interactive exhibit that would be housed at the Town Hall and be available at no charge to the public.


In addition, I will be requesting in the near future some modifications to the Council's grant program to allow for a specific application period. The current program does not include a request period; however, it is impossible to know what requests could come in during our budget process.

CITY OF GROVEPORT
REPORT TO MAYOR AND COUNCIL

PAGE 2 of 2

Upcoming Meetings:

03/14	Meeting with Columbus Sewer and Drains
03/15	Building Doctor
03/18	Preservation Committee
03/19	MORPC member roundtable
03/20	Safety Council
03/20	SEFC Chamber
03/22	Ohio Municipal League board meeting
03/27	Meeting re. water meter system

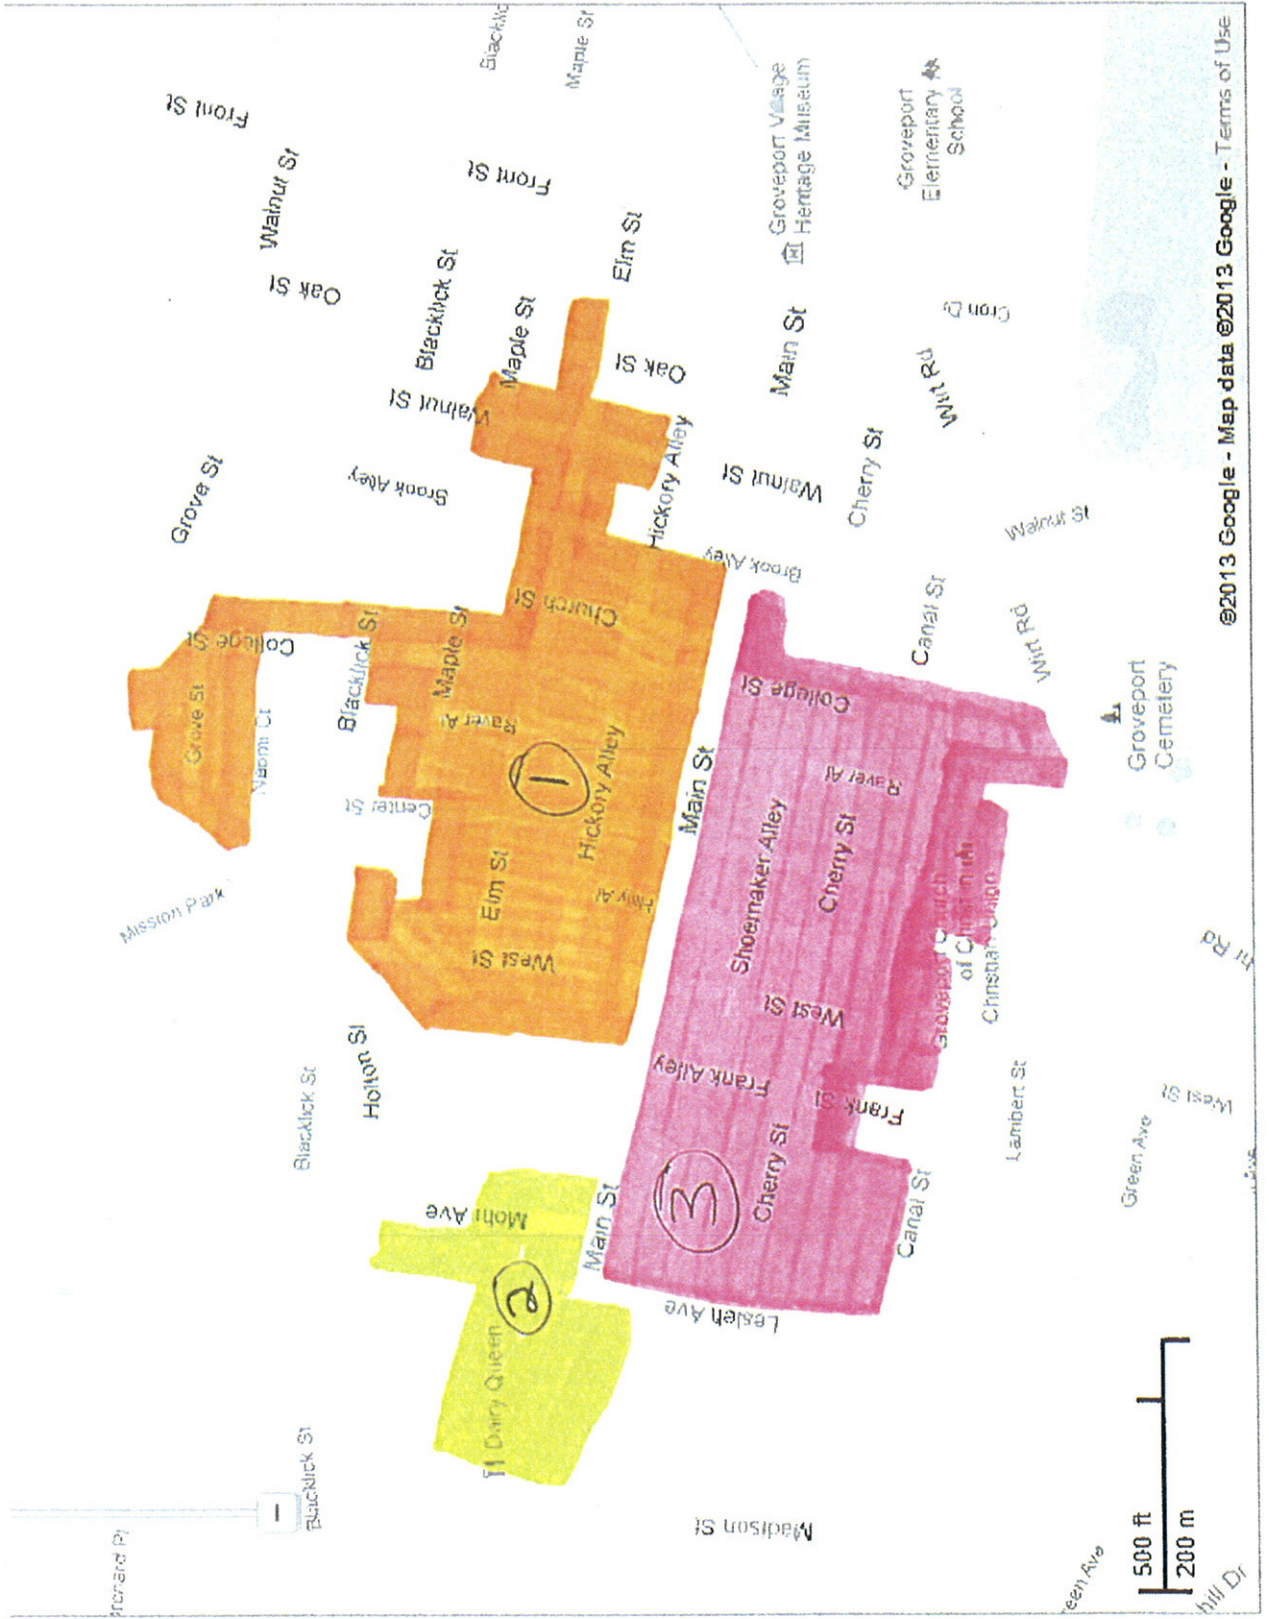

Customer Outage History Report
06/29/2012 to 02/28/2013

Area #1
GROVEPORT, OH

BIXBY STATION
0007107

NOTE: Highlighted values in the Total Outage Duration Minutes column indicates a step restoration. The customer for which this report was produced, may have experienced an outage time less than the total outage duration.

Interruption Start Date & Time	Major Cause Code Desc	Minor Cause Code Desc	Clearing Device Desc	Major Event Ind	Total Customer Affected	Total Outage Duration Minutes
06/29/2012 17:09	DISTRIBUTION LINE	WEATHER - HIGH WINDS (EXCEEDING 60 MPH)	FDR BKR	Y	989	649
07/01/2012 10:46	DISTRIBUTION LINE	WEATHER - HIGH WINDS (EXCEEDING 60 MPH)	LINE FUSE	Y	169	1,852
08/08/2012 16:43	DISTRIBUTION LINE	UNKNOWN	FDR BKR	N	989	MOMENTARY EVENT
08/09/2012 08:37	DISTRIBUTION LINE	TREE IN ROW	FDR BKR	N	989	MOMENTARY EVENT
10/19/2012 09:47	DISTRIBUTION LINE	UNKNOWN	FDR BKR	N	989	MOMENTARY EVENT
10/30/2012 09:18	DISTRIBUTION LINE	UNKNOWN	FDR BKR	N	989	MOMENTARY
12/08/2012 01:15	DISTRIBUTION LINE	EQUIPMENT FAILURE	FDR BKR	N	991	25
12/08/2012 09:22	DISTRIBUTION LINE	UNKNOWN	FDR BKR	N	991	MOMENTARY EVENT

NOTE: Tree contact related outages are cleared and/or removed and all equipment related outages were replaced/repared during the restoration effort. No further action is required unless otherwise noted. Durations listed as momentary are all operations that lasted less than five minutes from the first operation.

Customer Outage History Report
06/29/2012 to 02/28/2013

Area #2
GROVEPORT, OH

BIXBY STATION
0007107

NOTE: Highlighted values in the Total Outage Duration Minutes column indicates a step restoration. The customer for which this report was produced, may have experienced an outage time less than the total outage duration.

Interruption Start Date & Time	Major Cause Code Desc	Minor Cause Code Desc	Clearing Device Desc	Major Event Ind	Total Customer Affected	Total Outage Duration Minutes
06/29/2012 17:09	DISTRIBUTION LINE	WEATHER - HIGH WINDS (EXCEEDING 60 MPH)	FDR BKR	Y	989	649
08/08/2012 16:43	DISTRIBUTION LINE	UNKNOWN	FDR BKR	N	989	MOMENTARY EVENT
08/09/2012 08:37	DISTRIBUTION LINE	TREE IN ROW	FDR BKR	N	989	MOMENTARY EVENT
10/19/2012 09:47	DISTRIBUTION LINE	UNKNOWN	FDR BKR	N	989	MOMENTARY EVENT
10/30/2012 09:18	DISTRIBUTION LINE	UNKNOWN	FDR BKR	N	989	MOMENTARY
12/08/2012 01:15	DISTRIBUTION LINE	EQUIPMENT FAILURE	FDR BKR	N	991	25
12/08/2012 09:22	DISTRIBUTION LINE	UNKNOWN	FDR BKR	N	991	MOMENTARY EVENT

NOTE: Tree contact related outages are cleared and/or removed and all equipment related outages were replaced/repared during the restoration effort. No further action is required unless otherwise noted. Durations listed as momentary are all operations that lasted less than five minutes from the first operation.

Customer Outage History Report
06/29/2012 to 02/28/2013

Area #3
GROVEPORT, OH

BIXBY STATION
0007101

NOTE: Highlighted values in the Total Outage Duration Minutes column indicates a step restoration. The customer for which this report was produced, may have experienced an outage time less than the total outage duration.

Interruption Start Date & Time	Major Cause Code Desc	Minor Cause Code Desc	Clearing Device Desc	Major Event Ind	Total Customer Affected	Total Outage Duration Minutes
06/29/2012 17:14	DISTRIBUTION LINE	WEATHER - HIGH WINDS (EXCEEDING 60 MPH)	RECLOSER	Y	373	276
06/29/2012 17:16	DISTRIBUTION LINE	WEATHER - HIGH WINDS (EXCEEDING 60 MPH)	RECLOSER	Y	732	551
06/29/2012 17:42	DISTRIBUTION LINE	WEATHER - HIGH WINDS (EXCEEDING 60 MPH)	PRI OPEN	Y	1,105	4,268
06/29/2012 23:49	DISTRIBUTION LINE	WEATHER - HIGH WINDS (EXCEEDING 60 MPH)	RECLOSER	Y	732	1,031
07/02/2012 17:22	DISTRIBUTION LINE	WEATHER - UNKNOWN	LINE FUSE	Y	628	5,786
07/02/2012 17:34	DISTRIBUTION LINE	TREE OUT OF ROW	LINE FUSE	Y	99	5,752
07/05/2012 17:36	DISTRIBUTION LINE	WEATHER - HIGH WINDS (EXCEEDING 60 MPH)	RECLOSER	Y	711	197
08/31/2012 08:51	DISTRIBUTION LINE	ANIMAL - BIRD	FDR BKR	N	1,265	MOMENTARY EVENT
09/21/2012 09:00	DISTRIBUTION LINE	UNKNOWN (NON WEATHER)	LINE FUSE	N	99	110
12/08/2012 00:12	DISTRIBUTION LINE	EQUIPMENT FAILURE	TOT BKR	N	1,265	89

12/08/2012 01:41	DISTRIBUTION LINE	TREE INSIDE ROW	RECLOSER	N	1,112	154
12/08/2012 03:25	DISTRIBUTION LINE	TREE INSIDE ROW	RECLOSER	N	466	50
12/12/2012 11:30	DISTRIBUTION LINE	ANIMAL - NON BIRD	LINE FUSE	N	111	95
01/01/2013 12:02	DISTRIBUTION LINE	ANIMAL - NON BIRD	LINE FUSE	N	99	208

NOTE: Tree contact related outages are cleared and/or removed and all equipment related outages were replaced/repairs during the restoration effort. No further action is required unless otherwise noted. Durations listed as momentary are all operations that lasted less than five minutes from the first operation.